

5190243IB02**2020040605**

Test Result : A1-S1,d0

Report No : 2020040605

Applicant : FİXPER YALITIM VE YAPI KİMYASALLARI SAN. TİC. LTD. ŞTİ.

Address : Veliköy OSB. Mah. 5. Cad. No:6 C Blok No:5 Çerkezköy/TEKİRDAĞ

Contact Person : Yahya Korkut

Telephone: 0536 582 4167

E-Mail: yahya@fixper.com.tr

Sample Accepted on : 26.02.2020 12:30

Report Date : 04.06.2020

Report Pages : 5 Pages

Sample ID : Fireproof Plaster

	TEST	METHOD	RESULT
*	Fire classification of construction products and building elements-Part 1: Classification using test data from reaction to fire tests.	EN 13501-1	PASS High Performance fireproof
			A1 s1 d0



Seal

Customer Representative
Hasan KUTLULaboratory Manager
Hava Sarıaydın

EUROLAB® (TÜRCERT TEKNİK KONTROL VE BELGELENDİRME A.Ş.)

It is prohibited to change any and all versions of this document in any manner whatsoever. In case of a conflict between the electronic version (e.g. PDF file) and the original paper version provided by EUROLAB®, the latter will prevail.

TÜRCERT Teknik Kontrol ve Belgelendirme A.Ş. disclaim liability for any direct, indirect, consequential or incidental damages that may result from the use of the information or data, or from the inability to use the information or data contained in this document.

The contents of this report may only be transmitted to third parties in its entirety and provided with the copyright notice, prohibition to change, electronic versions' validity notice and disclaimer.

Environment

The requirements and standards apply to equipment intended for use in:

X	Residential (domestic) environment
X	Commercial and light-industrial environment
X	Industrial environment
X	Medical environment



EUROLAB LABORATUVAR HİZMETLERİ
TÜRCERT TEKNİK KONTROL VE BELGELENDİRME A.Ş.**RESULTS****1.TS EN ISO 13501-1**

Building products and structural elements, fire classification. Part 1: Classification by using data obtained from the behavior tests against fire.

This standard covers the behavior of all building products, including products used in combination with structural elements, against flame.

Provisions for Inspection and Test:

If Rule / Test Is Not Needed To Be Applied To Sample (Not Applicable To Sample)	NU
If the Specimen Fits the Rules (Passed)	P
If the Specimen Tested Does Not Comply with the Rules (Left)	K
If there is a Rule / Experiment Not Applied for Any Reason (Unable)	Y

Sample No	1	2	3	4	5	6
Fammability (Yes/No)	NO	NO	NO	NO	NO	NO
Whether the flame is spread (Yes/No)	NO	NO	NO	NO	NO	NO
Flame Spreading Time	-	-	-	-	-	-
Combustion on Filter Paper (Yes/No)	No	No	No	No	No	No
RESULT						
Observations Samples had an ignition. The flame did not reach the measurement line within the experimental period. No dripping, melting and burning, filter paper did not burn.						

Related Product Standard and Citations: Fire Response Test (EN 13501-1 A_{fl} Class)	
Conditioning Details: The test samples were conditioned at 23 ± 2 ° C and $50 \pm 5\%$ relative humidity at EN 13238 according to 4.3 C..	
Class A_{fl} (TS EN ISO 13501-1 Clause 8.3)	For the determination of conformity to Class A_{fl} , use a product, the time of exposure to flame according to TS EN 13501-1
Test Sample	Length -- mm , Width -- mm , Thickness — mm
Exposure Requirements	Surface exposed to flame

RESULT: Tests and tests were carried out according to the European Standard TS EN ISO 13501-1. The product has passed the test successfully.

"The result of this experiment is related to the behavior of the test specimen of a product under the special conditions in which the test is applied; Not a single criterion for assessing the potential fire hazard of a product under actual use. "



EUROLAB LABORATUVAR HİZMETLERİ
TÜRCERT TEKNİK KONTROL VE BELGELENDİRME A.Ş.

Reaction to fire

The combustion class (Euroclasses) of the product must be determined in accordance with EN 13501-1.

TS EN 13501-1 - Flammability Test (TS EN ISO 1182)

This test is carried out to determine whether a contribution to a fire is significant, regardless of the end use of a product.

Material	Rule / Test	Result / Evaluation	Decision
5	Test sample		
	---	---	PASS
6	Conditioning		
	<p>Test samples shall be conditioned as specified in EN 13238. The test samples should be dried and tested for 20 hours to 24 hours in an air-circulating oven with a temperature of (60 ± 5) ° C.</p> <p>it must be allowed to cool to ambient temperature in a desiccator before being held. The mass of each sample should be determined with a sensitivity of 0.01 g before the experiment.</p>	<p>Conditioning Time: 1 week Conditioning Temperature: 23 ± 2 ° C Conditioning Humidity: 50 ± 5%</p> <p>EN 13238 4.3 Conditioning for fixed period a) Minimum conditioning period of one weeks: 2) cement based products;</p>	PASS
8	<p>Display of results</p> <p>The mass loss measured mass loss is calculated and recorded in% for each of the five test samples.</p>		
8.1	<p>Flammability The measured total time of continuous exacerbation is calculated and recorded in seconds for each of the five test samples.</p>	1. test	<p>2.12 MJ/kg</p> <p>TS EN ISO 11925-2</p>
8.2	<p>Note 1: TS EN 13501 -1 Class A_{fl} Homogeneous and non-homogeneous products must meet the 1t ≤ 30 ° C and ,m ve 50% and tf = 0s criteria.</p>	2. test	<p>2.13 MJ/kg</p> <p>TS EN ISO 11925-2</p>
8.3	<p>Note 2: TS EN 13501-1 Class A_{fl} Homogeneous and non-homogeneous products must meet the Δt ≤ 50 ° C and Δm olmayan 50% and tf Sinif 20s criteria.</p> <p>Note 3: TS EN 13501-1 Class A_{fl} Homogen products shall meet the PCS ojen 2.0 MJ / kg criteria.</p>	3. test	<p>2.14 MJ/kg</p> <p>TS EN ISO 11925-2</p>

EUROLAB LABORATUVAR HİZMETLERİ
TÜRCERT TEKNİK KONTROL VE BELGELENDİRME A.Ş.

Classification of INSULATION PLASTER according to TS EN 13501-1 according to the behavior against fire:

A

Test method	Parameter	Number of tests	Mean of continuous	Results
			parameter	Suitable parameter
TS EN 13823	FIGRA _{0,2MJ} (W/s)	3	51,5	(-)
	LFS > side	3	(-)	No
	THR _{600s} (MJ)	3	3,2	(-)
	SMOGRA (m ² /s ²)	3	85,0	(-)
	TSP _{600s} (m)	3	103,7	(-)
	Drops and droplets (s)	3	(-)	No

(-): Not applicable

(1) Exposure of the surface to flame

(2): Exposure of the edge to flame (c) EN 14509: 2014 standard C.1.2.2.a)

Test method	Parameter	Parameter	Compliance criteria
TS EN 13823	FIGRA _{p 2 MJ} [W/s]	51,5	< 120 (B)
	THR _{600s} (MJ)	3,2	<7,5(B)
	LFS < side	(-)	Yes(B)
	SMOGRA [m ² /s ²]	85,0	<180 (s1)
	TSP _{600s} [m]	103,7	<200 (s1)
	burning drops / particles burning time (s)	No	No (d0)

(-): Not applicable

Classification of INSULATION PLASTER based on fire behavior:

A

Additional classification for smoke formation:

S1

Additional classification for burning drops / beads:


d0

Reaction to fire for INSULATION PLASTER

Flammability Behavior		Smoke			Burning Drops	
A	-	s	l	t	d	0



TEST IMAGES

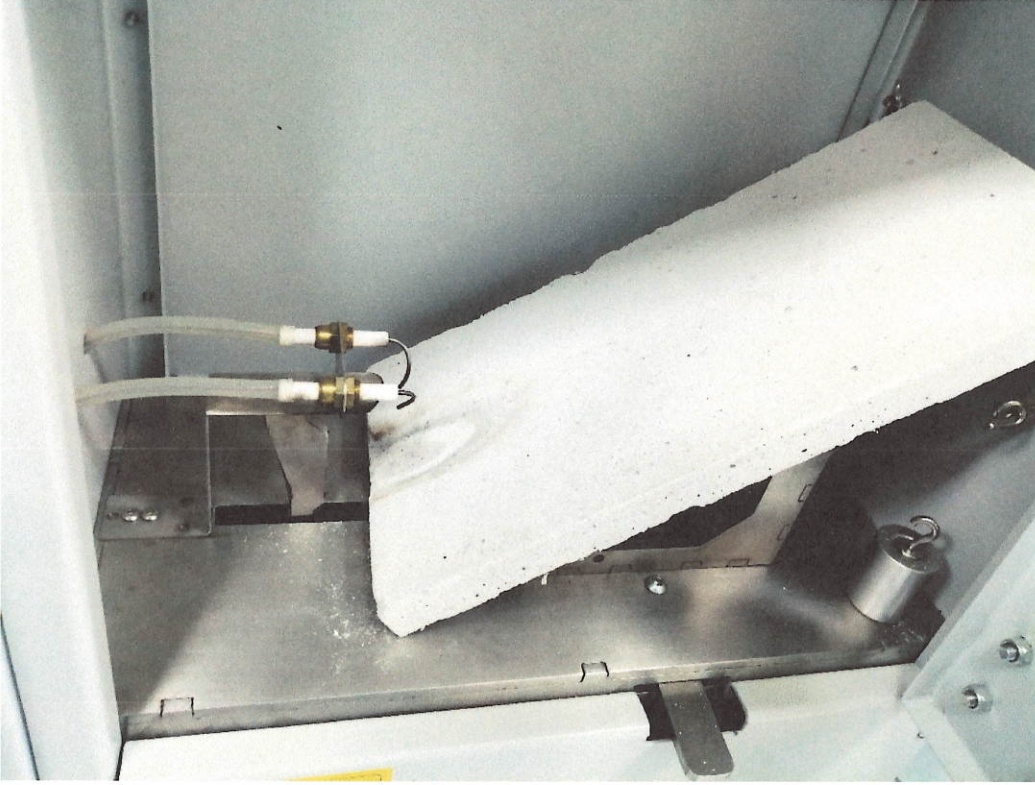

**** End of Report ****

